


(2) 1/2"  $\phi$  HOLES 1-3/4" FROM TOP OF THE BOX

METER BOX MUST BE APPROVED CONCRETE OR BRICK CONSTRUCTION WITH CONCRETE BASE

PLAN

RADIO READ UNIT (MXU) TO BE INSTALLED ON SERVICE LINES AS INDICATED BY METRO WATER SERVICE PERMIT OFFICE. REFERENCE DETAIL WDET 002A-1 FOR STANDARD METER BOX RADIO READ UNIT (MXU) CONDUIT AND MOUNTING LOCATIONS.

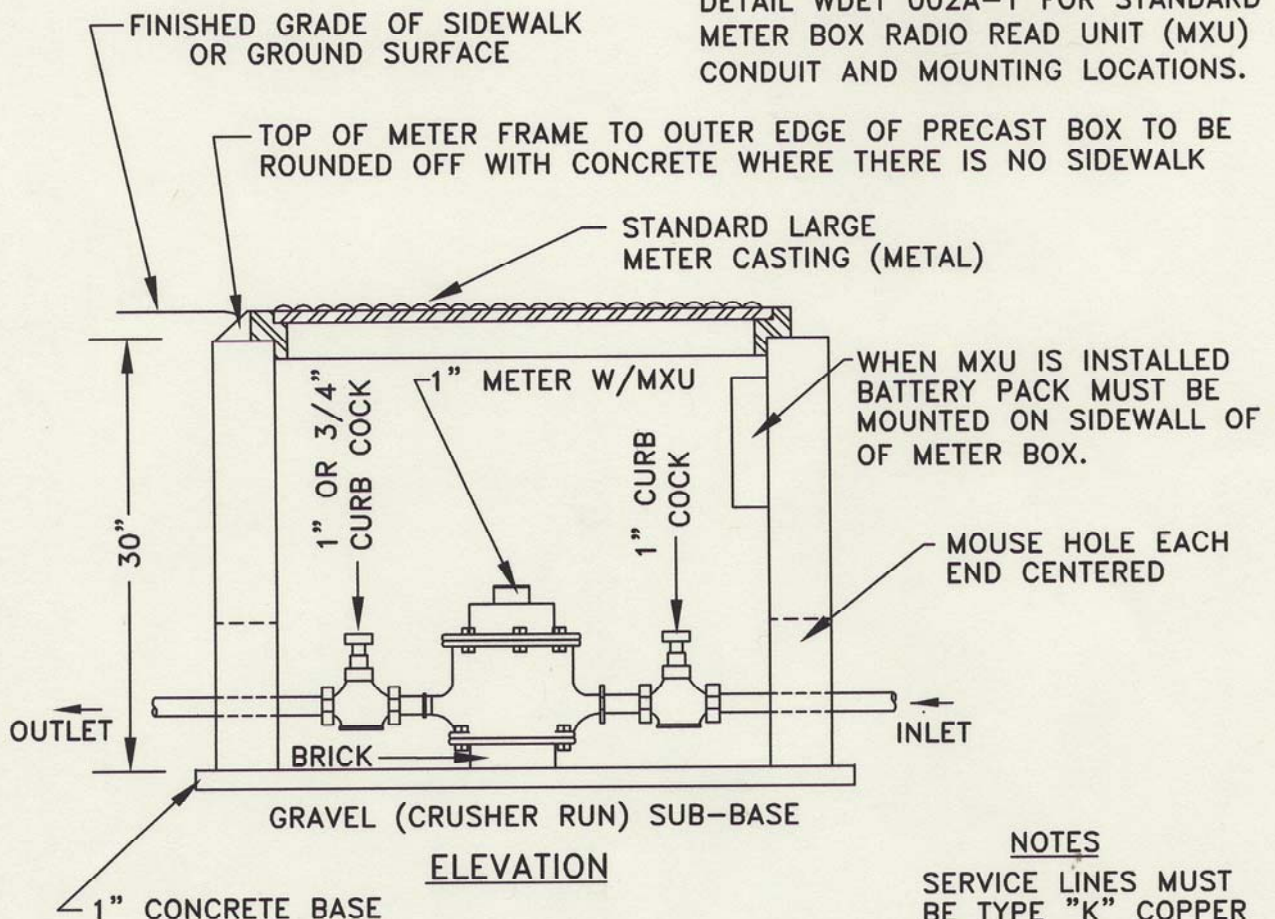

ELEVATION

NOTES

SERVICE LINES MUST BE TYPE "K" COPPER WITH FLARED FITTINGS IN METER BOX.

CONCRETE: 4500 PSI @ 28 DAYS

METRO WATER SERVICES

STANDARD 1" METER  
AND BOX DETAIL

*Hal Balthrop*  
LICENSED DISTRIBUTION OPERATOR

NOT TO SCALE DATE: 2/25/05

DWG. NO. WDET018

**METRO**  
WATER SERVICES

*[Signature]*  
DIRECTOR OF WATER AND SEWERAGE SERVICES